



Ultra - Pro Installation & Operations Guide





Installation & Maintenance Guide

Operation Overview

The ULTRA PRO range of Expansion Vessels is specifically designed for Unvented Potable Systems to deal with increased water volume resulting from heat expansion, Solving issues of “water hammer” phenomenon, or reducing number of pump operations or duration of pump run. All vessels of 100 Litres capacity or greater have a second water connection point at the top of the vessel which can be used for a variety of purposes.

Operation overview for Heat Expansion Purposes

The purpose of these vessels is to accommodate the increased liquid volume which occurs during system heating in an Unvented Circuit. A pressurised membrane allows ingress/egress of the liquid during periods of heating / cooling thus providing space for the expanded fluid volume to reside and prevent system pressure increase.

The sensible contraction of system water volume during cooling periods is enabled by means of a compressed air cushion which returns this temporarily expanded volume to the system.

The correct size of vessel must be considered prior to installation and installed by appropriately trained engineers. Careful consideration of pre charge must also be made as this is dependant on the application of the vessel. The larger size range available accommodates the larger systems and is also compatible with chilled water systems.

Operation overview for Water Hammer (Shock) Arrester Purposes

Also known as Hydraulic Shock, water hammer is a specific phenomenon and is not a “Catch all” phrase for noisy pipes. The fitting of an ULTRA PRO vessel will not resolve system noises where the root cause is excessive dynamic pressure, improperly clipped pipework or pipe bore restrictions due to clogged filters, burrs on cut pipe or excessive “bushing down” of distribution pipework.

Water hammer is caused when a water supply outlet is closed very suddenly. This causes a change in the momentum of the water when the system suddenly goes from a lower running pressure to a higher static pressure. This momentum impacts against the now closed outlet resulting in a potentially loud banging noise. This is commonly found in “quarter turn” type tap outlets and washing machines with solenoids controlling flow.

Siting a relatively small ULTRA PRO as close to the source of the noise as possible will cause the vessels diaphragm to flex in response to this momentum change and prevent the audible impact against the terminal fittings. The pre charge should ideally be set to just slightly above the dynamic pressure of the system it is fitted to. This principle also applies to Pressure Reducing Valves, where the momentum of changing water velocities can cause the PRV to be overwhelmed above it’s pre-set value.

Installation & Maintenance Guide

Operation overview for Pump Buffering

Expansion vessels may be used to prevent excessive pump operations by providing a buffer of stored water volume held at a pressure slightly above the "Pump ON" activation threshold. This means that for short operations, the system pressure is maintained by the compressed air cushion expelling the stored water volume into the system until it is empty or the pressure drops below the differential threshold of a pump controlling pressure switch, after this time the pump will kick in to continue with the system duty pressure. This system can also act as a "self priming" mechanism for certain pumps. Note some pumps may have a vessel already fitted for this purpose, please consult relevant manufacturer for any specific guidance in this area.

Installation Siting


The Expansion Vessel may be fitted to a very wide range of systems, different sources of heat are applied to Unvented Hot Water Systems, and as long as the temperature and pressure is controlled within normal limits, the ULTRA-PRO will be compatible in it's application.

Installations where the heat source is augmented by Solid Fuel, Solar Thermal or other heat sources with potentially uncontrolled input temperatures are not compatible with these vessels and an alternative model and installation method should be specified.

The physical siting and commissioning of the vessel should always be in accordance with the instructions relating to any associated equipment as each application may have a number of acceptable siting options or locations.

Expansion vessels should always be installed in a vertical orientation with the water connection at the bottom

Our requirements are simply that the vessel be installed in a way that allows future access, and ideally be in the coolest available part of the system to assist with longevity of the membrane. At no time can a vertical vessel be mounted horizontally, or be mounted to a wall or framework suspended by it's legs.

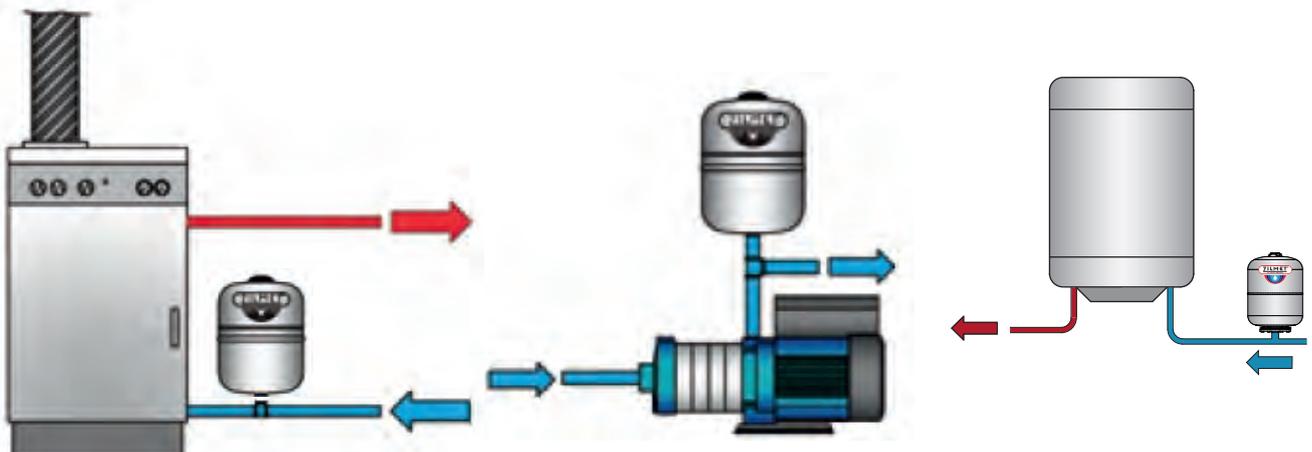



Installation & Maintenance Guide

The UK Water Supply Industry Recommendations for Pressure testing state:-

“When testing rigid pipe systems all the outlets in the installation should be sealed and all float operated valves should be capped off or isolated. The water pressure should then be increased, by pumping, until the internal water pressure at the lowest point of the installation is 50% above the normal operating pressure. This pressure should be maintained for one hour without further pumping”.

Where the expansion vessel is concerned, there may be times when this testing procedure will take the system pressure to something in excess of the maximum working pressure. At times like this there is the potential to burst the membrane. This is due to the tremendous strain that the membrane is subjected to in these conditions, which is caused ultimately by a greatly increased “acceptance factor”.

The acceptance factor in this case is essentially the percentage of the overall vessel volume which is filled.

In order to successfully pressure test the system without endangering the membrane, it is necessary to increase the pre charge of the vessel temporarily to a magnitude that prevents the acceptance factor exceeding 40% while the maximum working pressure is exceeded.

The method of calculating the increased pre charge required is:-

Where,

P_i = Initial charge pressure (Absolute) - This should equal the value of the static system pressure minus 0.2 Bar.

P_f = Maximum operating pressure (Absolute) of the Safety Relief Valve, taking into account any differences in height between the vessel and the safety relief valve.

$$(P_i / P_f) \times 100 = \text{acceptance factor}$$

If acceptance factor exceeds 40% then increase P_i until this is not so.

P_i = final value of pre charge required before system pressure test.

For example if the normal operating pressure of a system is 9 Bar, then the expected test pressure for the system is 13.5 Bar.

Because this exceeds the maximum working pressure, the pre charge should be temporarily increased to something like 5.4 Bar or more if possible. In this way, the integrity of the vessel is still tested properly without undue risk to the membrane.



Installation & Maintenance Guide

Sizing

The appropriate sizing of an expansion vessel must be undertaken by qualified or appropriately trained engineers. Due to the variable nature of pump control systems we regrettably can provide no further specific examples or guidance for pump applications other than heat expansion.

$$V = \frac{e \times C}{1 - P_i/P_f}$$

V = Expansion Vessel Size

e = Expansion Co-efficient corresponding to the difference between the cold water system temperature and the maximum working pressure.

In standard plants:-

$$e = 0.02244$$

C = Total Water Capacity of the system in Litres

P_i = Initial charge pressure (Absolute) - This should equal the value of the static system pressure minus 0.2 Bar.

P_f = Maximum operating pressure (Absolute) of the Safety Relief Valve, taking into account any differences in height between the vessel and the safety relief valve.

Temp	e Value
0	0.00013
10	0.00025
20	0.00174
30	0.00426
40	0.00782
50	0.01207
55	0.01450
60	0.01704
65	0.01980
70	0.02269
75	0.02580
80	0.02899
85	0.03240
90	0.03590
95	0.03960
100	0.04343

Example - Relating to Potable Heat Expansion

C = 300 Litres

P_i = 3.3 Bar (4.5 Bar atmospheric)

P_f = 6 Bar (7 Bar Atmospheric)

$$V = \frac{0.02244 \times 300}{1 - (4.3 / 7)}$$

$$V = 18.7$$

Nearest vessel size with this capacity = 24 Litres

Maintenance

The vessel requires inspection at least once a year (or as and when a drop in performance is noted from the system). The vessel must be visibly inspected for pinholes in the metal body of the vessel and the air pressure must be checked against the required pre-charge. Some pressure loss is to be expected and should be rectified to within a reasonable accuracy but a significant drop in air pressure may signify that the vessel membrane is nearing the end of its life span and may require replacement. Some provision should be made within a wider piece of equipment for access and inspection. Full instructions regarding membrane replacement are available separately.

The air pressure may only be inspected when the vessel is either detached completely from the system or when the system itself is de-pressurised to atmospheric pressure.

Over time, the flanges of a vessel with an interchangeable vessel will be exposed to repeated strain, eventually this may give rise to leaks from the flanged connections. These flanges are replaceable and are available in both Stainless and Galvanised Steel.



Installation & Maintenance Guide

Materials

Shell: Carbon Steel

Connection: Stainless Steel

Membrane: Butyl / EPDM

Max Operating Temperature: 99°C

Colour: Blue

Code	Capacity	Diameter	Height	Length*	Pmax	Pre charge	Connection
	(Litres)	(mm)	(mm)	(mm)	(Bar)	(Bar)	(BSP)
1100002406	24 Horizontal	270	290	485	10	1.5	1" G
1100002419	24 Vertical	270	485	-	10	1.5	1" G
1100005007	50 Horizontal	380	410	560	10	1.5	1" G
1100005006	50 Vertical	380	770	180*	10	1.5	1" G
1100006007	60 Horizontal	380	410	640	10	1.5	1" G
1100006006	60 Vertical	380	860	170*	10	1.5	1" G
1100008007	80 Horizontal	450	480	640	10	1.5	1" G
1100008006	80 Vertical	450	830	153*	10	1.5	1" G
1100010007	100 Litre Horizontal	450	480	730	10	1.5	1" G
1100010006	100 Litre Vertical	450	910	153*	10	1.5	1" G
1100020007	200 Litre Horizontal	550	580	985	10	1.5	1 1/2" G
1100020006	200 Litre Vertical	550	1235	210*	10	1.5	1 1/2" G
1100030007	300 Litre Horizontal	630	660	1140	10	1.5	1 1/2" G
1100030006	300 Litre Vertical	630	1365	188*	10	1.5	1 1/2" G
1100050006	500 Litre Vertical	750	1560	188*	10	1.5	1 1/2" G
1100075057	750 Litre Vertical	750	2075	150*	10	1.5	1 1/2" G
1100100056	1000 Litre Vertical	850	2100	120*	10	1.5	1 1/2" G

*dimension is from floor to connection

Installation & Maintenance Guide

Materials

Shell: Carbon Steel

Connection: Galvanised / Stainless Steel


Membrane: Butyl / EPDM

Max Operating Temperature: 99°C

Colour: Blue / Red

Code	Capacity (Litres)	Diameter (mm)	Height (mm)	Length (mm)	Pmax (Bar)	Pre charge (Bar)	Connection (BSP)
1100002423	24 Vertical	270	485	-	16	2	1" G
1100002435	24 Horizontal	270	290	485	16	2	1" G
1100010055	100 Vertical	450	910	-	16	2	1" G
1100020052	200 Vertical	550	1235	-	16	2	1 1/2" G
1100030048	300 Vertical	630	1365	-	16	2	1 1/2" G
1100050050	500 Vertical	380	860	-	16	2	1 1/2" G
1100075060	750 Vertical	380	860	-	16	2	1 1/2" G
1100100060	1000 Vertical	850	2100	-	16	2	1 1/2" G


24 Litre Horizontal

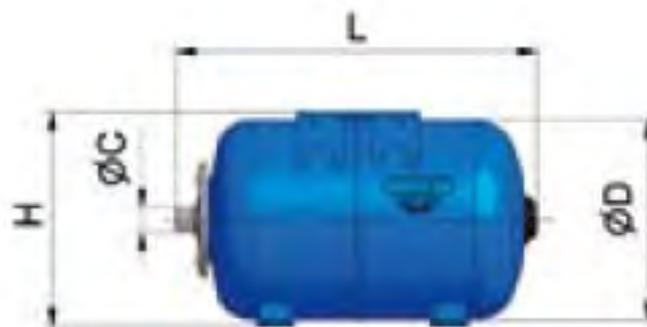

Installation & Maintenance Guide


100 - 500 Litre Vertical

24 Litre Vertical

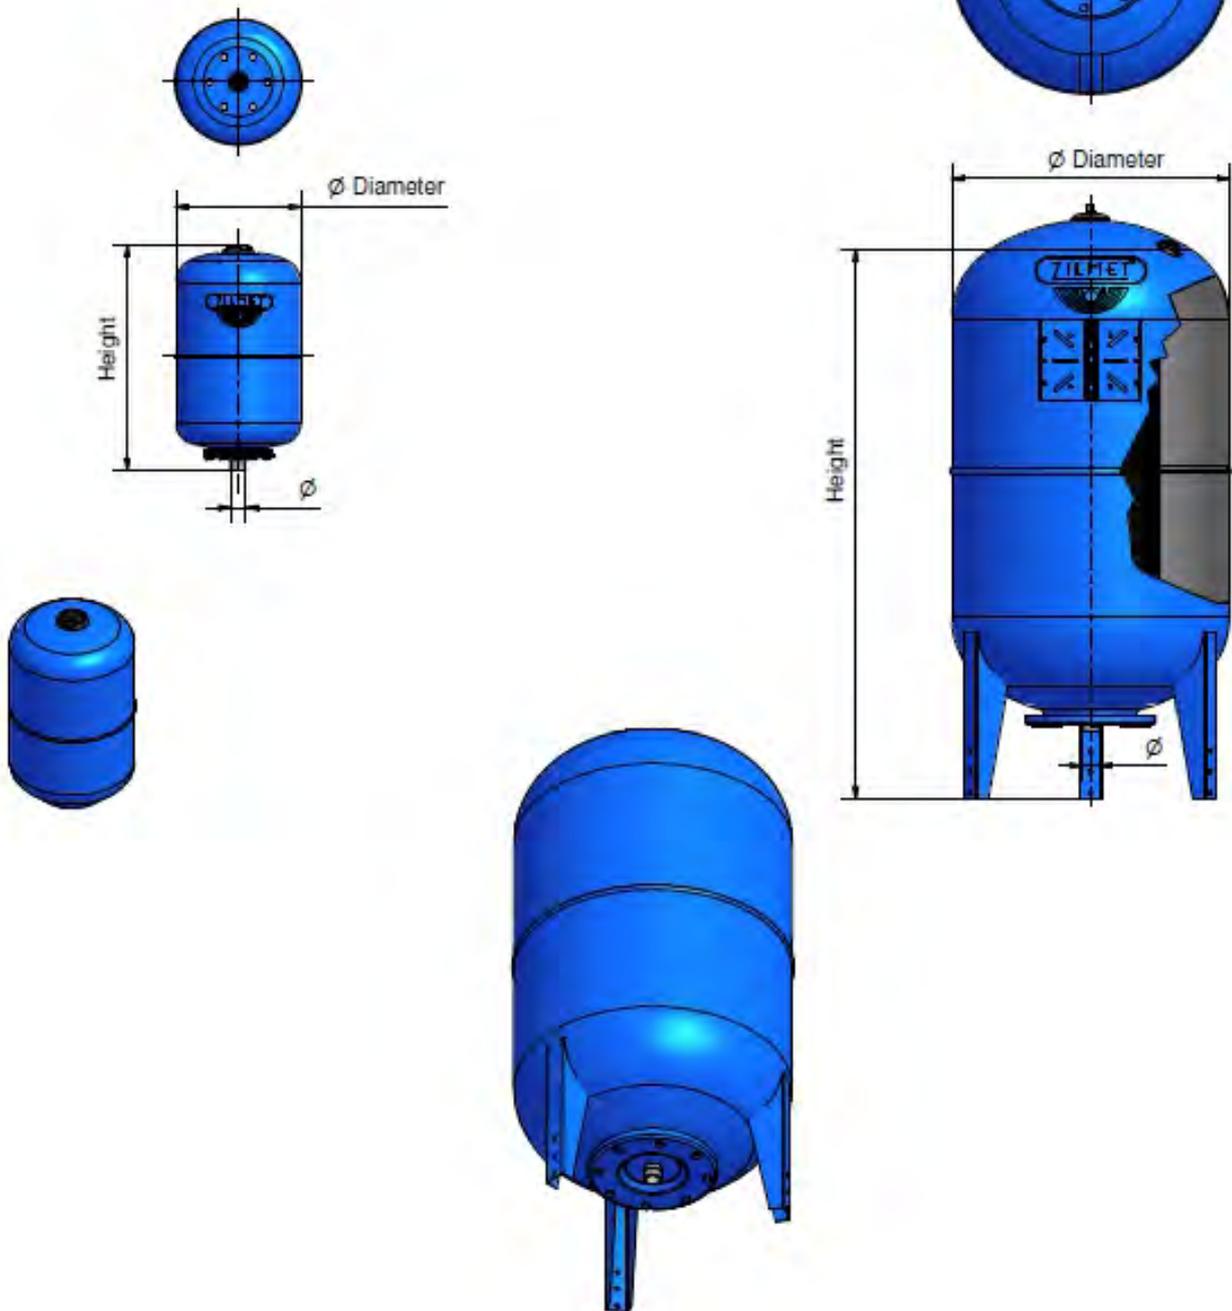


Installation & Maintenance Guide

750 - 1000 Litres Vertical

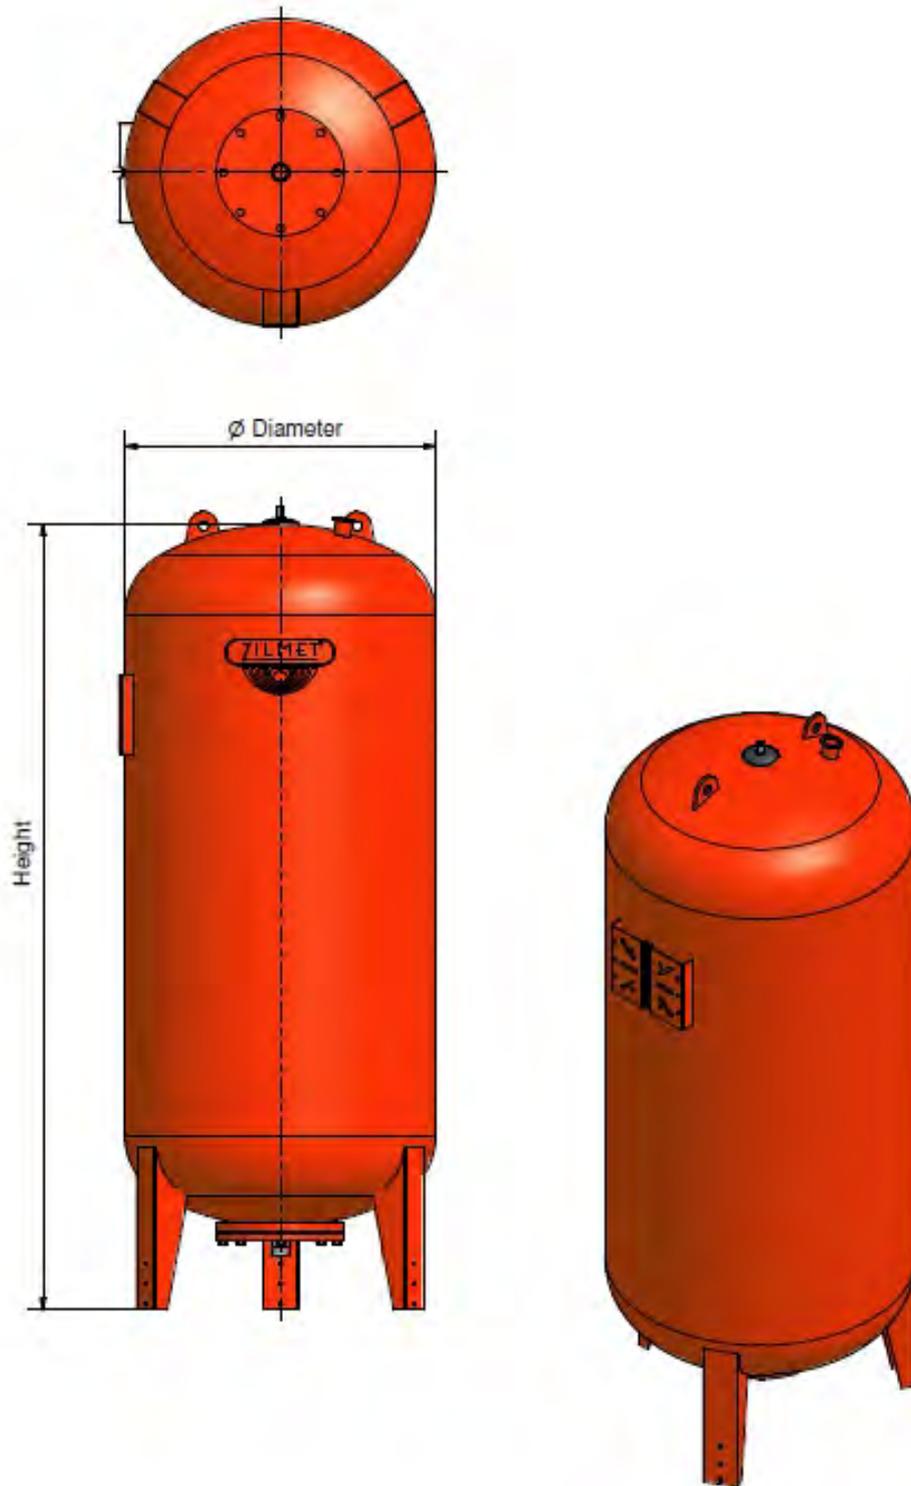

Installation & Maintenance Guide

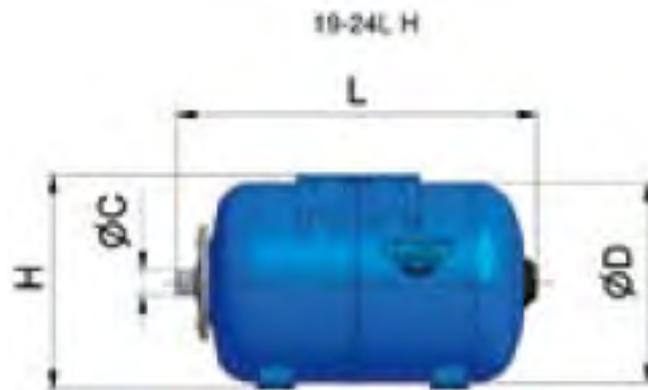



Notes



ULTRA-PRO



Zilmet UK Ltd. Airfield Industrial Estate, Hixon,
Staffordshire, ST180PF
t: 01889272185, F: 01889272191
web: www.zilmet.co.uk, E Mail: sales@zilmet.co.uk
E & OE